


BANDAGE JOINT - CROSS SECTION

NTS

BANDAGE JOINT REQUIREMENTS		
PIPE DIAMETER (D)	THICKNESS (T)	WIDTH (W)
D < 900	100	400
D ≥ 900	150	600

PROVIDE 'DENSO 600' TAPE OR SIMILAR APPROVED TAPE TO BE 200mm MIN. WIDTH AND LAPPED 100mm MIN. TAPE IS TO BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS.

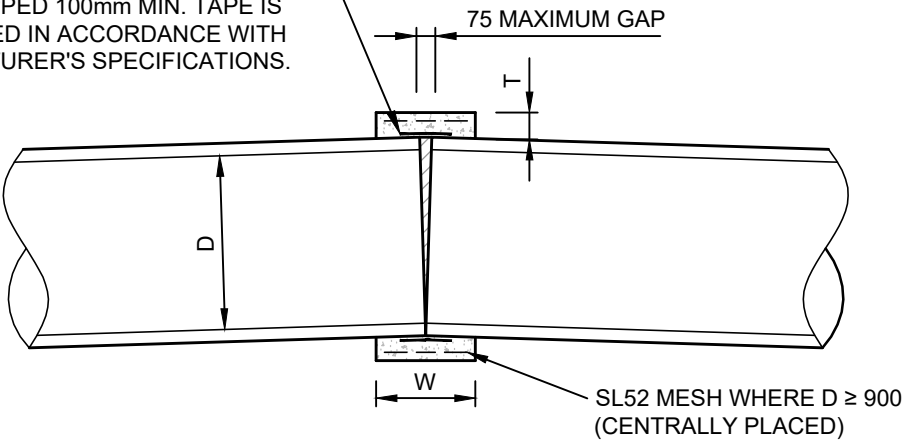

BANDAGE JOINT - LONGITUDINAL SECTION

NTS

NOTES:

1. CONCRETE STRENGTH TO BE 32MPa UNLESS NOTED OTHERWISE.
2. FOR CRACKS, HOLES OR OPENINGS WIDER THAN 5mm, 'DENSO 600' TAPE OR SIMILAR APPROVED SHALL BE USED. TAPE TO BE 200mm MIN. WIDTH AND LAPPED 100mm MIN. TAPE IS TO BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS.
3. MORTAR MIX TO CONSIST OF 3 PARTS SAND TO 1 PART CEMENT BY VOLUME.
4. ONLY TO BE USED IF DIRECTED BY CoA REPRESENTATIVE.

APPLICATION:

WHERE INSTALLATION OF A JUNCTION BOX OR JUNCTION CHAMBER IS NOT POSSIBLE.

CoA 390

BANDAGE JOINT

REV	DESCRIPTION	DATE
A	ORIGINAL ISSUE	02/23

CONSTRUCTION STANDARD

DRAINAGE

BANDAGE JOINT



SHEET NUMBER
DR090

REVISION
A