


**PARK LANDS - GENERAL
INCLUDING EVENTS AREAS**

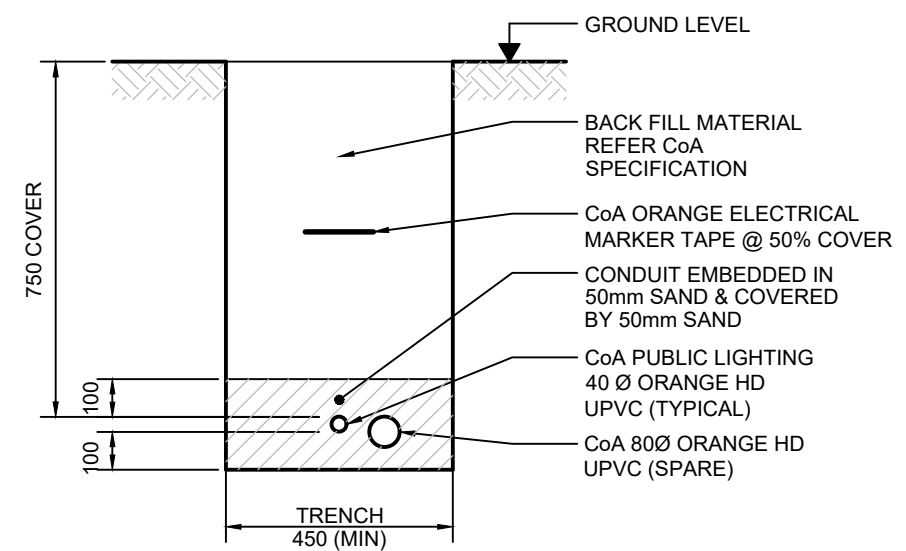


PARK LANDS - PATHWAY LIGHTING

(FOR PUBLIC LIGHTING UNDER OR ADJACENT TO PATHWAYS, WHERE CABLE ROUTE IS CLEARLY DEFINED. CONTACT CoA PROJECT MANAGER TO DETERMINE ACCEPTABLE LOCATIONS)
IT IS NOT TO BE USED IN EVENT AREAS.

NOTES:

1. COORDINATE DUCTING REQUIREMENTS WITH ALL SERVICE AUTHORITIES.
2. MAINTAIN SEGREGATION TO EXISTING AND PROPOSED SERVICES.
3. ALL SPARE CONDUITS TO BE TERMINATED, CAPPED & FITTED WITH POLYPROPYLENE DRAW WIRE. MIN BREAKING STRAIN 600kg.
4. PROVIDE PERMANENT METAL ROUND CABLE MARKERS WITH CONCRETE SURROUND AND DIRECTION ARROWS IN ACCORDANCE WITH AS/NZS 3000.

CoA 866 TRENCHES - PARK LANDS

REV	DESCRIPTION	DATE	CONSTRUCTION STANDARD LIGHTING & ELECTRICAL		 CITY OF ADELAIDE
A	ORIGINAL ISSUE	10/22			
			TRENCHES PARK LANDS		
			SHEET NUMBER LE066		REVISION A